



Islanding Detection of Distributed Generation Resources Using Negative Sequence Component of Voltage

O. Alizadeh Musavi

Dept. of Electrical Engineering
AmirKabir University of technology
o_alizademusavi@yahoo.com

A. Helmzadeh

Dept. of Electrical Engineering
Ferdowsi University of mashhad
helmzadeh@yahoo.com

J. Sadeh

Dept. of Electrical Engineering
Ferdowsi University of mashhad
Javadsadeh@um.ac.ir

Abstract- Distributed generation (DG) provides many potential benefits, such as peak shaving, improved power quality and reliability, increased efficiency, and improved environmental performance. Along with the development of distributed generation, especially renewable energy resources which have been increasingly considered because of environmental concerns and oil crisis, research projects dependent on these resources are being followed with more attention and sensitivity. Among these researches anti-islanding protection of distributed generation units whose duty is preventing of the operation of these resources during network disconnection is one of the most important projects related to distributed resources. In this paper a new method for anti-islanding protection of synchronous generator using negative sequence component of voltage and its damping pattern is presented. The proposed method is simulated and test in various operation conditions. The test results showed that the method correctly detects the islanding operation and does not mal-operate in the other situations.

Key-words- distributed generation, anti-islanding protection, negative sequence component of voltage.

1- INTRODUCTION

By definition, any type of generation with relatively low power (a few kilo watts to 10 MW) which is close to the consumer or in its place, can be considered as distributed generation [1]. With the introduction of restructuring to the electrical industry, small scale plant owners can compete with each other by using natural resources including wind, water and solar resources and creating advantages like speed of construction and operation, reducing transmission cost, helping

local economic and increasing power quality. Therefore a common approach is participation of distributed generation resources in supplying power to the grid. Besides advantages that using DG in the distribution system offers, it also has its own problems. Complicating the process of grid protection is perhaps the greatest disadvantage of using DG resources in the distribution system. A common situation which might make the protection of distributed system difficult is the islanding operation of DG resources.

An island is a region that consists of one or more DG which feed the loads independent of the grid due to the function of switches [2-3]. Available DG resources can form islands with the operation of fuses or reclosers. Because of different formation of switches in the distribution system, islanding is a complicated and unpredictable phenomenon. In other words, considering that the level of unbalance between production and consumption of active and reactive power in an island can have different values, frequency and voltage variations of the island is ambiguous. Detection of islanding operation is of extreme importance because in addition to the possibility of sever damage to network instruments and consumers, network personnel and even ordinary people are exposed to severe wounds and even death. Nowadays the accepted method is to drop every DG units out of the network as soon as the feeder is cut to prevent



possible damages to network instruments and personnel [4-5].

The paper is organized as follows. Section 2 explores various alternative islanding detection methods. Section 3 describes the proposed algorithm for island detection of DG units including simulation results insisting on the reliability of the method.

2- ISLANDING DETECTION METHODS

Various techniques have been advised to detect islanding operation of DG units. These methods are classified in two groups depending on their function. The first group is communication based procedures and the second are local procedures. The main advantage of communication based procedure is their independence on the DG unit type. In these methods signals are sent to detect the island. Depending on the signaling method communication based procedures are divided into two groups. One approach is to send trips via electro magnetic waves or phone lines to communicate with the DG unit and the other one is to use transmission lines for signaling. By considering the fact that a transmitter is needed for every switch and communication lines must cover every situated DG unit, the trip transmission method is very expensive. The use of transmission lines for signaling has many advantages. The reliability of this procedure is extremely high since it only uses one transmitter. This method has two drawbacks. First is the expense of the signal generator so if the number of DGs is not high, this method might not be economical. Second is the possibility of interference of the transmitter signal with other communication applications of the transmission line [6-7]. Local procedures for detection of islanding operation use available voltage and current signals in generator's place. These methods are classified into two groups of passive and active. In passive methods judgment is made only according to the value of voltage and current signals in generators place while in the active methods some disturbance signal are injected to the system and the situation of the island is detected according to the measured

response of the system. Usage of local procedures is completely dependent on the type of DG.

One of the most important infrastructures in detection of island operation by local procedures is the existence of a region in which island detection in an acceptable time is not possible. The region is called non-detection zone. The extent of non-detection zone in frequency or voltage based methods is a function of unbalance between generation and consumption of active or reactive power. In other words for the relay to operate in a reasonable time the unbalance between generation and consumption of power in the island must be higher than a critical limit. For reducing the extent of the non detection zone or increasing the sensitivity of the method, the rate of variation in power parameters can be used as a comparison criterion of the anti-islanding procedure [8-9].

Basically relays that use rate of change in power parameters such as frequency, have a major problem called unwanted trip. In other words there are cases that these relays turn off the generator even without the formation of an island. This problem becomes critical when there are more than one DG units in the feeder. The probability that relays based on rate of change in power parameters causes unwanted turn down of other generators is very high.

So a suitable anti-islanding method, besides detecting island operation of DG units in an acceptable time, must have the least malfunction in case of other disturbances such as switching of capacitor banks or big loads.

In some local schemes proposed the THD of the current and voltage unbalance of the DG terminal output as new monitoring parameters for power islanding detection [10]. These proposed parameters are capable of correctly detecting the islanding operation not affected by variation of DG loading, like the frequency and voltage based schemes. These schemes have a good selectivity for islanding conditions and non islanding conditions.

In following, a new algorithm for detection of islanding operation of DG units using negative sequence components of voltage and its damping pattern is introduced. Simulation results using

MATLAB shows that this procedures in addition to detecting the island situation correctly, dose not face the unwanted trip problem.

3- PROPOSED ALGORITHM

The reason of negative voltage creation in synchronous generators can be analyzed considering the voltage profile of phases during islanding. As can be seen in “Fig. 1” the phase voltage of the generator varies instantaneously.

This change curves at a different time for every phase. With respect to the unbalance between voltage phases, negative sequence component of voltage will have a non-zero value during islanding. In this way suitable anti-islanding procedure would be to compare the negative sequence component of voltage with a predefined value. However, if value of the negative sequence component of voltage is considered alone problems related to voltage relays including capacitor and parallel line switching would still exist. Our proposal for correction the mentioned algorithm is to use the damping pattern of negative sequence component of voltage when islanding happen. The value of negative sequence component of voltage damps steadily during islanding. Therefore using the value of negative sequence component of voltage and its damping pattern a suitable criterion for detection of islanding operation may be achieved. This phenomenon can be seen in “Fig. 2”.

This figure shows the simulation results for the network in “Fig. 3”. In the simulation process one of the parallel lines enter the circuit at $t=1$. Then the mentioned line is dropped out at $t=3$ and by disconnection of the other line at $t=5$, the synchronous generator (DG_1) functions as an island.

As can be seen in “Fig. 2”, in addition to the amplitude of negative sequence component of voltage at islanding instance ($t=3$), its damping pattern differs greatly from the other disturbances. Simulation results related to other disturbances including capacitor switching or the entrance of another DG unit is analyzed in section 3-2.

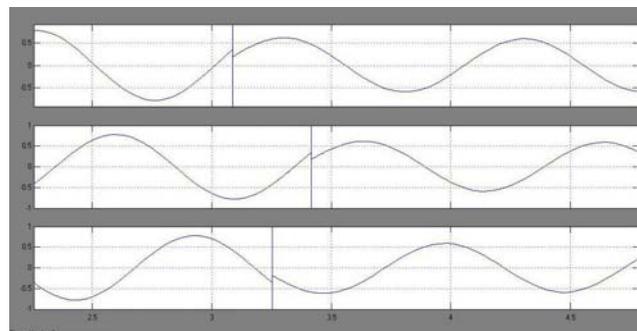


Figure 1. Phase voltage profile during islanding.

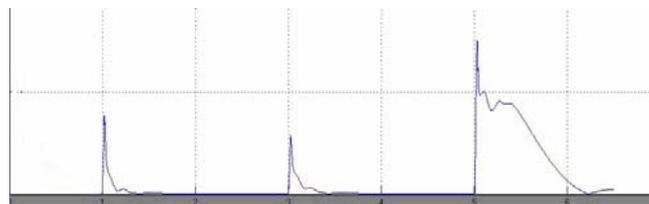


Figure 2. Negative sequence component of voltage and it's damping pattern.

3-1- Proposed algorithm simulation in a sample system

Available network in figure 3 include 132 kV and 50 Hz transmission system with 100 MVA short circuits which modeled with voltage source and impedance. Transmission system trough a, 132 kV/20 kV transformer connected to distribution system. DG_1 and DG_2 units are 5 MVA synchronous generators. DG units have voltage control system (AVR) and first frequency control. Distribution network begin with a 1MVAR capacitor C for power factor correction. Values are: $P_{D2}=2$ MW, $Q_{D2}=0.5$ MVAR, $P_{D3}=5$ MW and $Q_{D3}=2$ MVAR.

For analyzing situation and other disturbance in network, the following states have been considered:

State 1: disconnect one of parallel line by switch CB_1 .

State 2: connect one of the parallel lines by switch CB_1 .

State 3: disconnect two parallel lines by switch CB_2 . In this state DG unit disconnect from network and DG_1 operate islanding.

State 4: isolation of DG unit (DG_1) from system by disconnecting switch CB_3 and thus, its islanding.

State 5: change in DG unit load. In this simulation maximum load variation supposed to be 15% which considered with addition load of 15% load 1 to DG₁.

State 6: disconnecting a big load (load 3) near DG units.

State 7: connect capacitor C with switch SW₁.

Seven aforementioned states are simulated for the following 5 systems.

System 1: P_{D1}=2 MW, Q_{D1}=1 MVAR.

System 2: P_{D1}=1 MW, Q_{D1}=0.5 MVAR.

System 3: P_{D1}=6 MW, Q_{D1}=3 MVAR.

System 4: in this system effect of change in distribution line length had been analyzed. Here increase line length from 4 km to 40 km.

System 5: in this section analyze effect of adding DG unit 2 to system. For this purpose using switch SW₂, DG unit 2 is connected to distribution system trough a 5 km line. System variations are so that after each simulation its parameters are changes to its default system (system 1). Totally 35 different situation have been analyzed that each case is numbered with two digits, the first digit shows state number and the second digit shows system number, for example (1,2) shows first state(disconnect one of parallel line) and system 2 (P_{D1}=1 MW , Q_{D1}=0.5 MVAR).

Proposed algorithm for anti-islanding protection use negative sequence of voltage and its damping pattern after get to maximum value. In order to consider the damping effect, maximum value of negative sequence component of voltage is multiplied by its value 0.1 second after maximize. Now use these values as a comparison criterion.

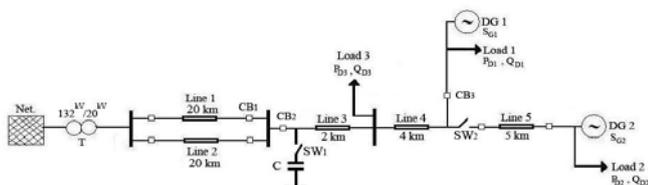


Figure 3. Single line diagram of studied network

3-2- Simulation results

These simulation results (35 modes) have been shown in "Fig. 4". Each column of this figure indicates one of situation noted in section 3-1, respectively. Thus third and fourth columns show two islanding situation of synchronous generator.

As it seen, minimum value in these two columns are considerably greater than other columns. For comparison between minimum value of islanding and maximum value of other disturbance, apart of "Fig. 4" has been magnified in "Fig .5". Results in figure 5 show reliability of proposed procedure. Relay setting that its function based on this algorithm can be choice between two dashed lines as shown in "Fig .5".

Asymmetric faults and loads are the only problem that faced this algorithm. In these cases because of unbalance in phase's voltage, negative sequence component of voltage has non-zero value. So to conquer this problem it's necessary to modify the mentioned algorithm.

As shown in "Fig. 6" the value of negative sequence during faults and asymmetric loads not only has not damping but also its value increases after a transient.

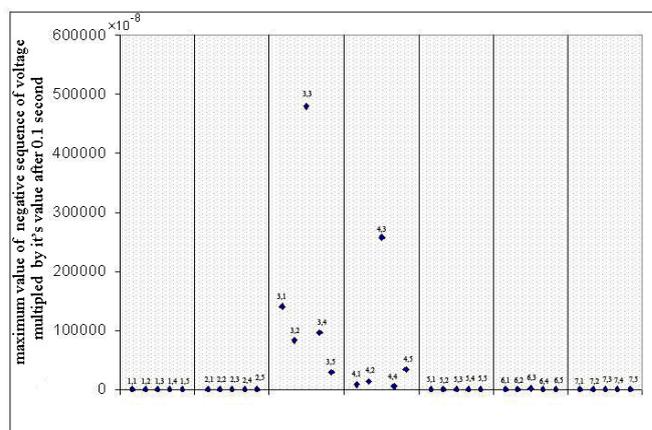


Figure 4. Maximum value of negative sequence of voltage multiplied by its value after 0.1 second

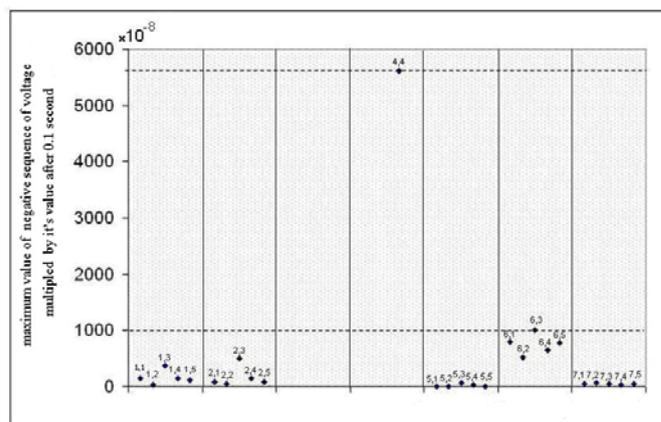


Figure 5. Maximum value of negative sequence of voltage multiplied by its value after 0.1 second

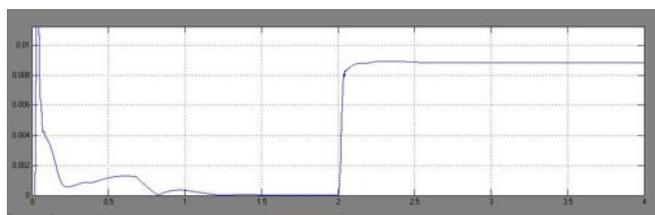


Figure 6. Negative sequence of voltage profile during asymmetric faults

In order to distinguish the islanding operation of synchronous generator and asymmetric faults, the proposed algorithm in “Fig. 7” will be efficient.

Simulation results prove that using this method has the least unwanted trip and maximum reliability in detection of islanding operation of distributed generation.

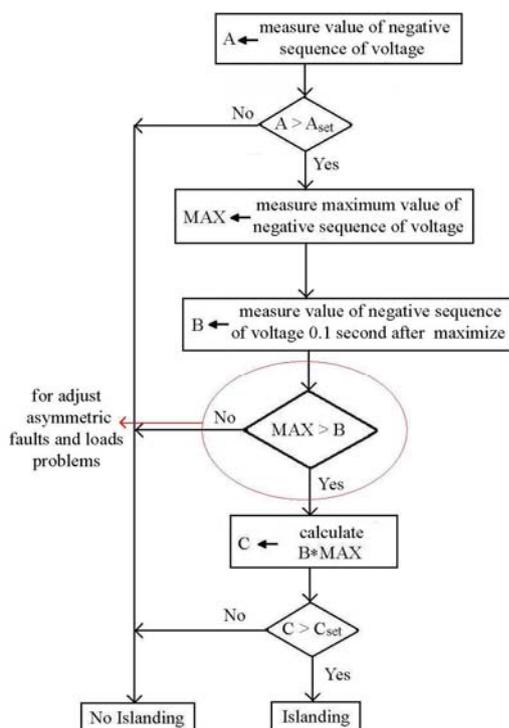


Figure 7. Proposed algorithm for negative sequence of voltage relay

4- CONCLUSION

In this paper a new method for anti-islanding protection of DG units is presented. In this method the negative sequence component of voltages and its damping pattern has been used. In order to consider the damping effect, the maximum value of negative sequence component

of voltage is multiplied by its value after a specific duration of time; simulation results insisted on the reliability of the approach.

In other words using relays specified in this algorithm not only reduces the extent of non detection zone but also shows no malfunction in presence of other system disturbances. A method for distinguishing between islanding operation of DG unit and asymmetric faults was also explored.

REFERENCES

- [1] T.Ackermann , G.Andersson and L.Soder, “Distributed generation: a definition”, Electric Power Systems Research 57 , 195–204,2001.
- [2] R. Walling and N. Miller, “Distributed generation islanding-implications on power system dynamic performance,” vol. 1, Chicago, WI USA, July 2002.
- [3] D. Rajicic, “A method for determination whether a network is connected or split,” IEEE Power Eng. Rev., vol. 21, no. 7, July 2001.
- [4] IEEE Standard for Interconnecting Distributed Resources with Electric Power Systems, IEEE, Standards Coordinating Committee 21, July 2003.
- [5] R. M. Rifaat. “Critical Considerations for Utility/Cogeneration Inter-Tie Protection Scheme Configuration”, IEEE Trans. on Industry Applications, Vol. 31, N 5, September/October 1995. pp 973 – 977.
- [6] M. A. Referrn , O. Usta, G. Fielding. “Protection Against Loss of Utility Grid Supply for a Dispersed Storage and Generation Unit”, IEEE Trans. on Power Delivery , Vol.8, No. 3, July 1993. pp 948 - 954.
- [7] C. J. Mozina. “Interconnection Protection of IPP Generators at Commercial / Industrial Facilities”, IEEE Trans. on Industry Applications, Vol. 37, No. 3, May / June 2001. pp 681 –689.
- [8] C.M. Affonso, W. Freitas,W.Xu and L.C.P da silva, “Performance of ROCOF relays for embedded generation applications” IEE Proc. Gener. Transm. Distrib., Vol. 152, No. 1, 2005.
- [9] S.K. Salman, D.J. King and G. Weller, “New loss of main detection algorithm for embedded generation using rate of change of voltage and change in power factors” IEE pub No.479, 2001
- [10] [10] Sung-II Jang and Kwang-Ho Kim, “Anti Islanding Detection Method for Distributed Generations Using Voltage Unbalance and Total Harmonic Distortion of Current” IEEE Trans. on Power Delivery, Vol. 19, No. 2, pp.745-752, April 2004